

Material : AG1123300 - CRUSHED #4
Supplier : BESTWAY - Bestway Aggregates
Supplier Ref No. :
Source : Church-McKay Pit
Grading Specification : ASTM C33 #4
Report Text 1 :
Report Text 2 :

Date : 31 Jul 2018
Sample Date From : 22 Jul 2018
Sample Date To : 28 Jul 2018


% Passing

Sample Date	Sample ID	2"	1-1/2"	1"	3/4"	3/8"	FM	SG	Absorp
	Min Pass	100.0	90.0	20.0	0.0	0.0			
	Max Pass	100.0	100.0	55.0	15.0	5.0			
7/23/2018	70995	100.0	100.0	53.0	2.0		7.00		
7/24/2018	70998	100.0	100.0	38.0	1.0		7.00		
7/25/2018	71001	100.0	100.0	54.0	3.2	0.2	7.00		
7/26/2018	71003	100.0	100.0	85.0	12.0	0.2	7.00		

	2"	1-1/2"	1"	3/4"	3/8"	FM
Count	4	4	4	4	4	4
AVG	100.0	100.0	57.5	4.5	0.1	7.00
STDEV	0.0	0.0	19.7	5.0	0.1	0.00
Range Min	100.0	100.0	38.0	1.0	0.0	7.00
Range Max	100.0	100.0	85.0	12.0	0.2	7.00
COV	0.0	0.0	34.3	110.9	115.5	0.00

Fineness Modulus 6.9990

Average Grading

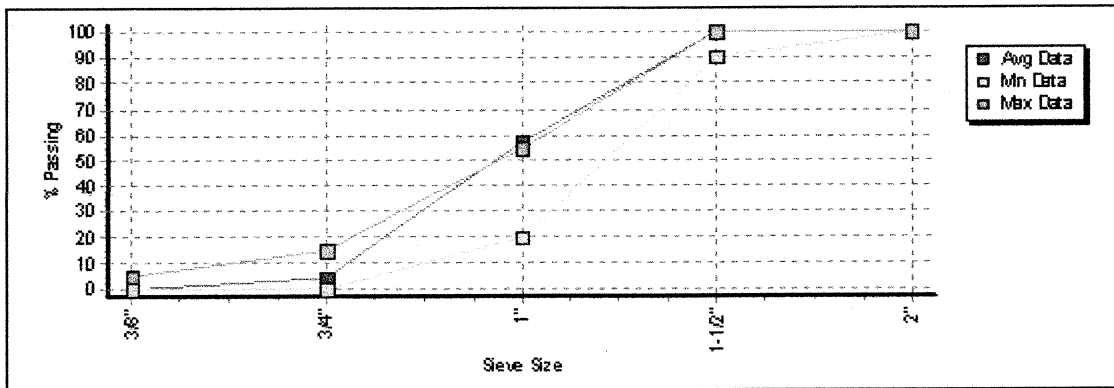

Approved By :

Daniel Bentz, P.E.

Certification # :